
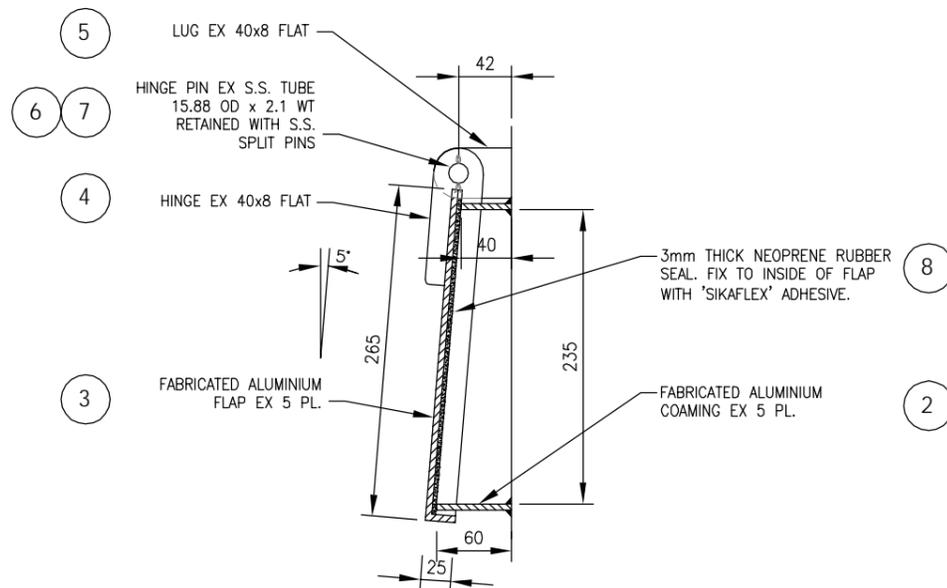


END ELEVATION

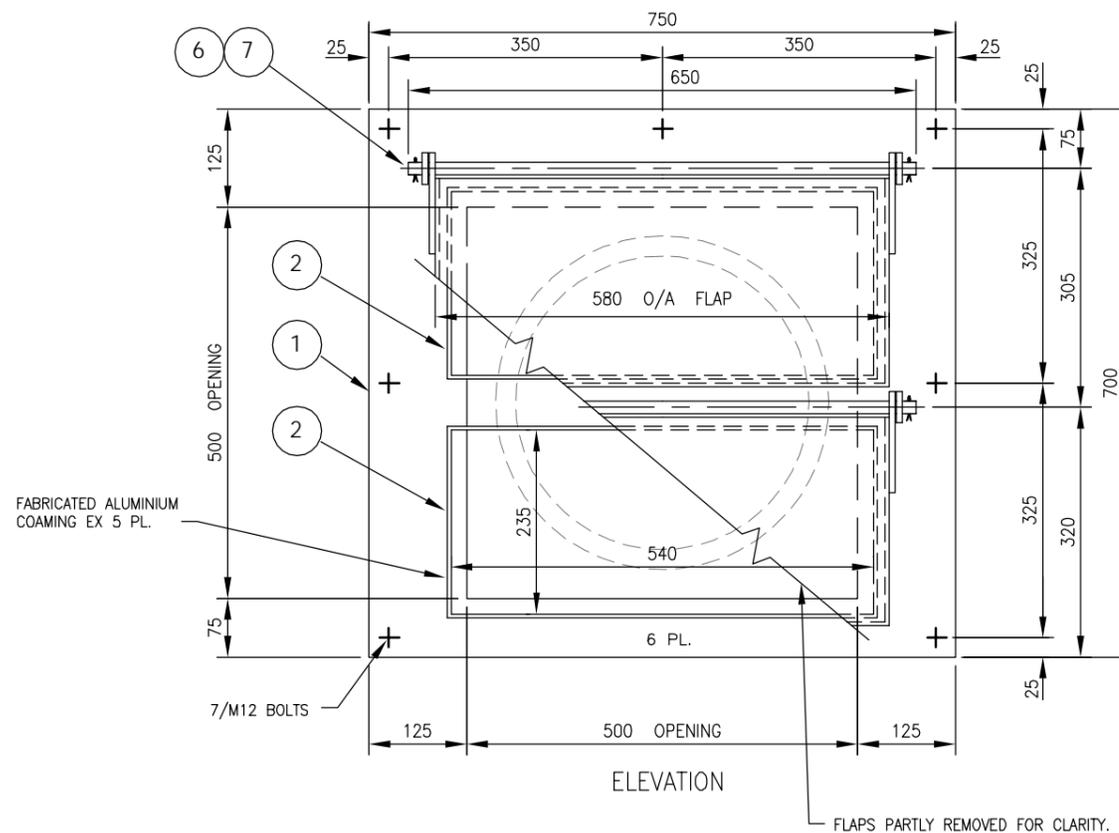

MATERIAL LIST				
MARINE GRADE ALUMINIUM				
ITEM	SECTION	LENGTH	DESCRIPTION	No REQ'D
1	700x6 PLATE	750		1
2	60x5 FLAT	1580	FABRICATED COAMING	2
3	290x5 PLATE	630	FABRICATED FLAP	2
4	40x8 FLAT	120		2
5	40x8 FLAT	62		2
STAINLESS STEEL				
6	TUBE	650	15.88 OD x 2.1 WT	2
7	SPLIT PIN	40	-	4
NEOPRENE RUBBER				
8	630x290x3 THICK NEOPRENE RUBBER SHEET			2

NOTES

1. ALL METALWORK SHALL BE MARINE GRADE ALUMINIUM.
2. ALL WELDS 5mm FULL DEPTH FILLET WELDS TO AS 1665 U.N.O..
3. ALL BOLTS TO BE STAINLESS STEEL TO AS 2837/316 WITH NUTS AND WASHERS TO AS 2837/304 WITH APPROVED ANTI-GALLING COMPOUND.

DISCLAIMER The Cairns Regional Council shall have no liability or responsibility to the user or any other person or entity with respect to any liability, loss or damage caused or alleged to be caused, directly or indirectly, by the adoption and use of these Standard Drawings including, but not limited to, any interruption of service, loss of business or anticipatory profits, or consequential damages resulting from the use of these Standard Drawings. Persons must not rely on these Standard Drawings as the equivalent of, or a substitute for, project-specific design and assessment by an appropriately qualified professional.



STANDARD DRAWING

**PUMP STATION OVERFLOW PIT
DOUBLE FLAP VALVE**

DRAWING NUMBER

S3037-CRC

REV	A	B		
-----	---	---	--	--

No.	Description	Date
B	REDRAWN	28/11/12
A	ORIGINAL ISSUE - SUPERSEDES S3035-CRC	OCT 08
Approved for use GM Infrastructure Services		