



RURAL RESIDENTIAL ZONE

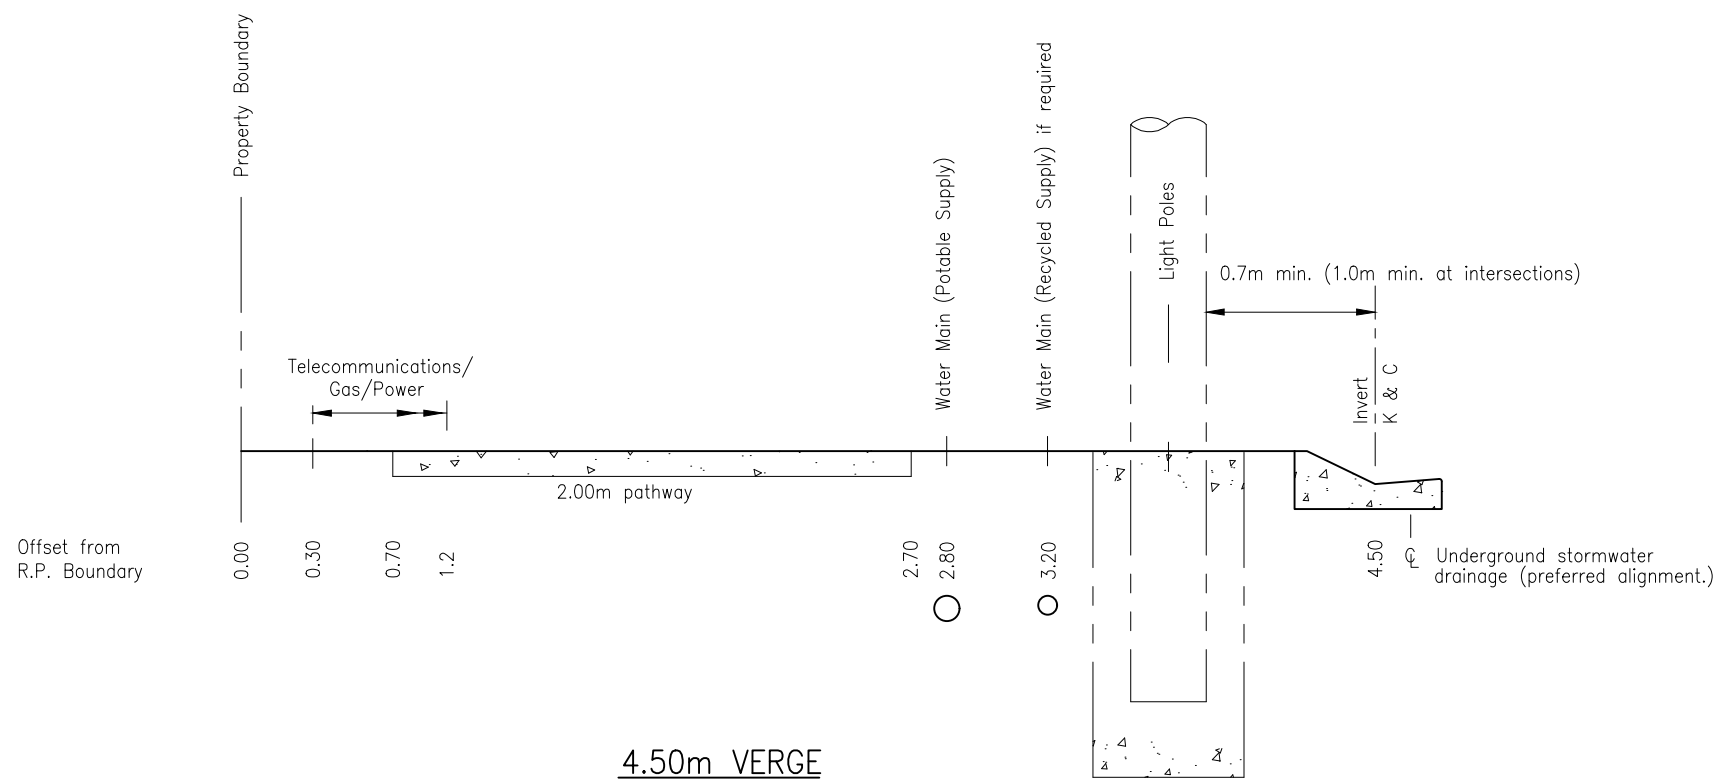

4.50m VERGE

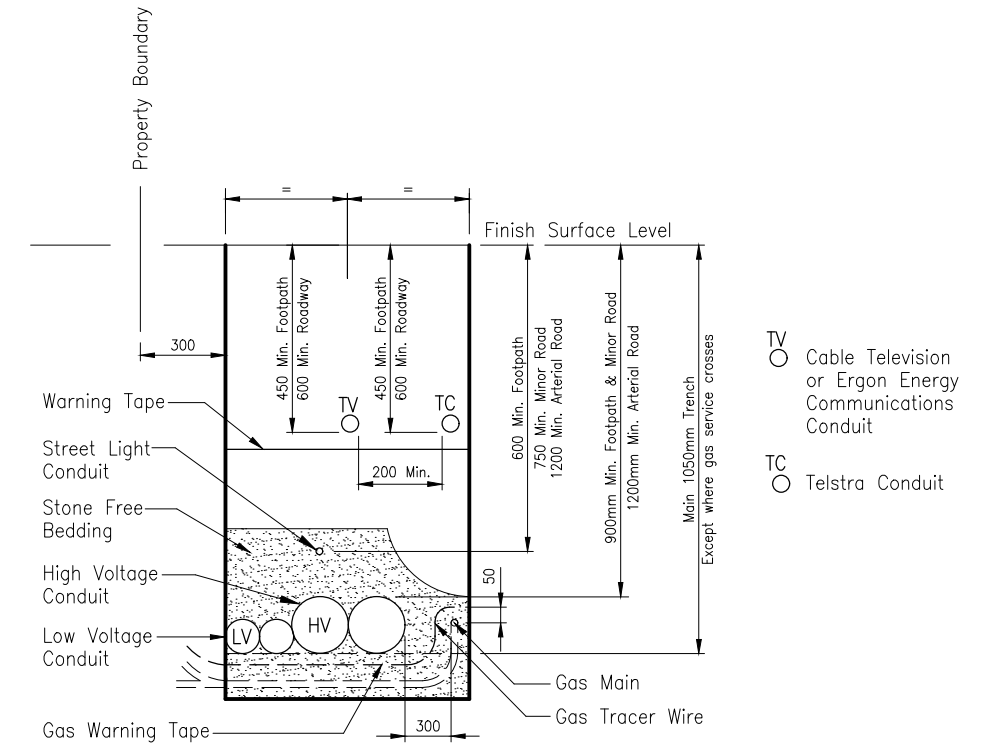

NOTES

1. Minimum trench width without gas to be 400mm.
2. Minimum trench width with gas to be 600mm.
3. 150mm minimum horizontal clearance between Power & Telecommunications.
4. 300mm minimum clearance between Power & Gas.

TELECOMMUNICATIONS/GAS/POWER SHARED TRENCH ARRANGEMENT

GENERAL NOTES

1. Sewer should not be on footpath but where such cannot be avoided and subject to Council approval, it should be on the opposite side verge to Telecommunications, Gas and Power.
2. Brass indicator discs to be placed in kerb over all conduit crossings.
3. All dimensions in metres unless otherwise stated.
4. Refer to D8-Utilities.
5. Preferred location of water main to be on opposite side of road to light pole to avoid clashes.

REVISIONS	DATE
C MINOR AMENDMENTS	05/12/23
B MINOR AMENDMENTS	20/10/17
A ORIGINAL ISSUE - SUPERSEDES S1010-CRC	26/11/14

DISCLAIMER
 The authors and sponsoring organisations shall have no liability or responsibility to the user or any other person or entity with respect to any liability, loss or damage caused or alleged to be caused, directly or indirectly, by the adoption and use of these Standard Drawings including, but not limited to, any interruption of service, loss of business or anticipatory profits, or consequential damages resulting from the use of these Standard Drawings. Persons must not rely on these Standard Drawings as the equivalent of, or a substitute for, project-specific design and assessment by an appropriately qualified professional.



PUBLIC UTILITIES ON ROAD VERGES

Standard Drawing
S1010

A	B	C		
---	---	---	--	--