


STANDARD ARRANGEMENT OF 20mm WATER SERVICE INSTALLATION (BLUE)

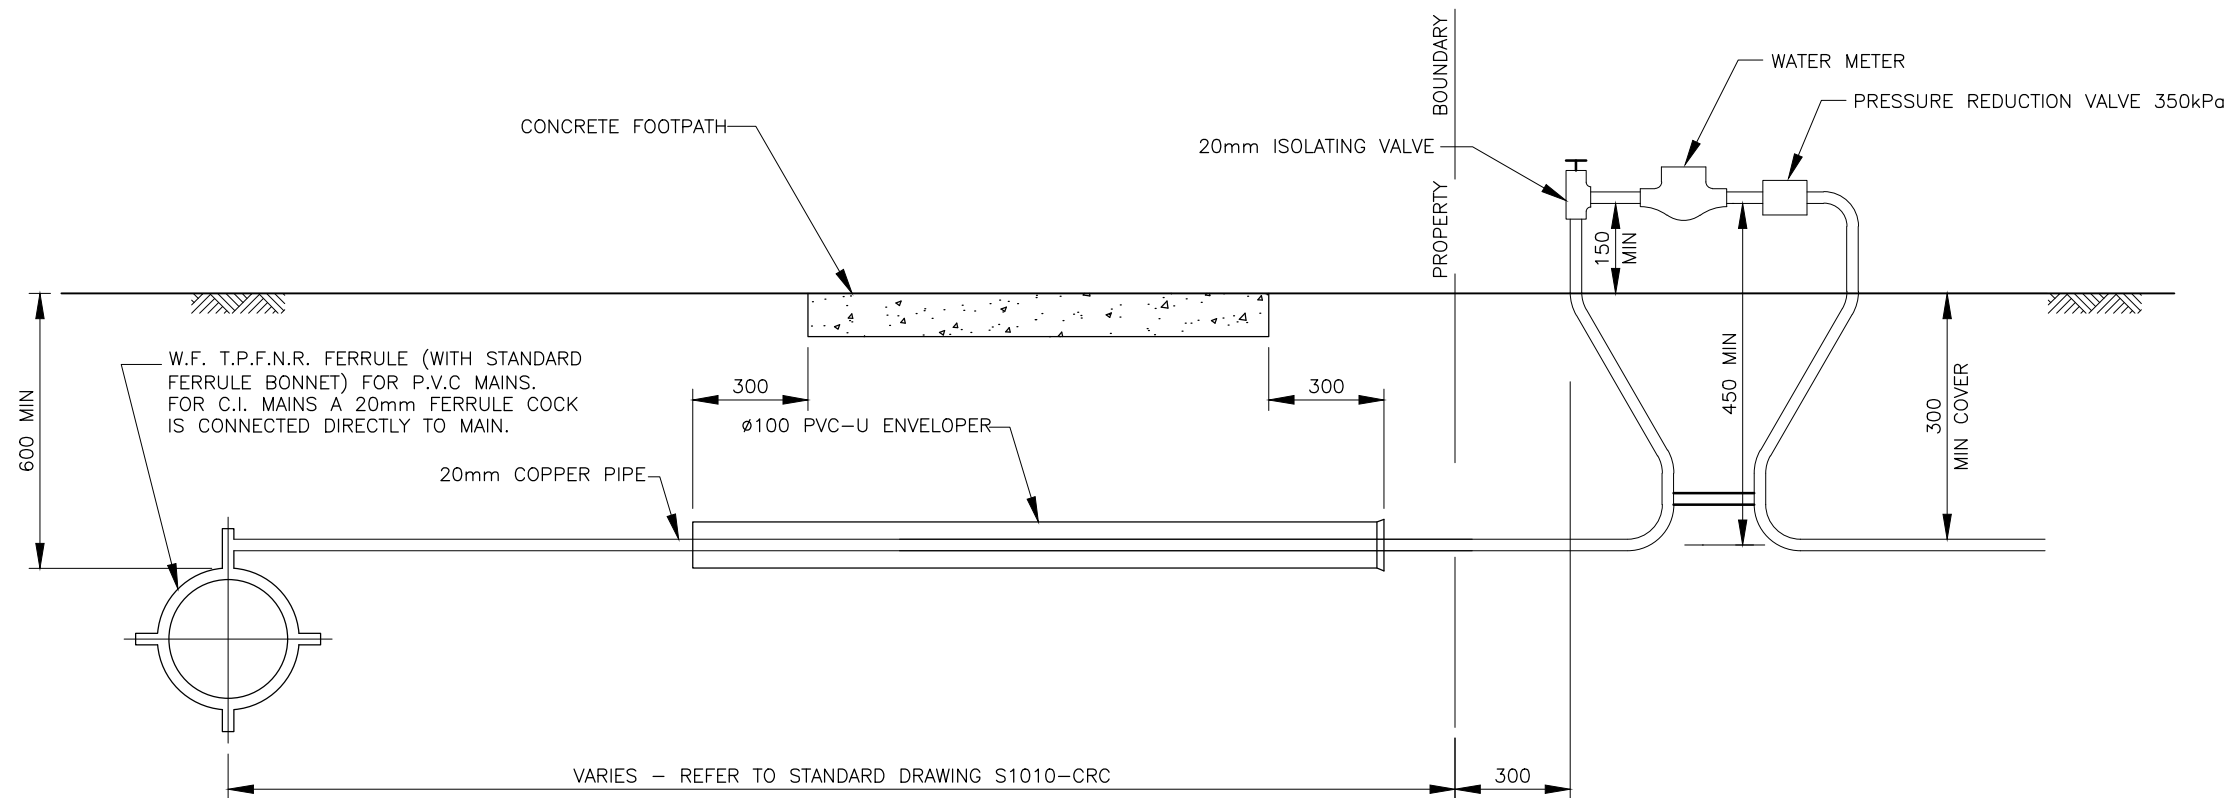

STANDARD ARRANGEMENT OF 20mm RECYCLED WATER INSTALLATION (LILAC)

NOTES

1. ALL CONNECTIONS ARE TO BE UNDERTAKEN BY COUNCIL.
2. STANDARD DOMESTIC SERVICE IS 20mm.
3. NORMAL LOCATION OF WATER SERVICE IS TO BE ON OPPOSITE BOUNDARY TO ELECTRICITY SUPPLY. WHERE IT IS LOCATED ON THE SAME SIDE AS THE ELECTRICITY, THEN IT SHALL BE 1.5M AWAY.
4. NORMAL WATER SERVICE LOCATION TO BE 300mm INSIDE THE FRONT BOUNDARY AND OFFSET 300mm FROM THE SIDE BOUNDARY.
5. NORMAL POSITION OF CONDUITS UNDER FOOTPATHS (WHERE REQUIRED) OFFSETS ARE TO BE AS PER FNQROC DEVELOPMENT MANUAL D6.10. NOMINALLY SHALL BE A MINIMUM OF 80mm DIAMETER PVC CLASS 6 WITH 300mm COVER. 300mm OFFSET FROM THE SIDE BOUNDARY AND EXTEND 300mm PAST THE EDGE OF THE FOOTPATH.
6. THE POSITION OF CONDUITS UNDER FOOTPATHS SHALL BE CLEARLY MARKED BY THE CASTING OF NON-FERROUS CUPHEAD BOLT INTO THE PROPERTY SIDE OF THE FOOTPATH WHILE THE CONCRETE IS WET.
7. FOOTPATH WIDTHS TO BE CONFIRMED BY COUNCIL.

REVISIONS	DATE
C DIMENSION CHANGED NOTES ADDED	05/12/23
B DIMENSION CHANGED, NOTES ADDED	27/08/20
A ORIGINAL ISSUE - CRC DRAWING ADOPTED	28/11/12

DISCLAIMER
 The authors and sponsoring organisations shall have no liability or responsibility to the user or any other person or entity with respect to any liability, loss or damage caused or alleged to be caused, directly or indirectly, by the adoption and use of these Standard Drawings including, but not limited to, any interruption of service, loss of business or anticipatory profits, or consequential damages resulting from the use of these Standard Drawings. Persons must not rely on these Standard Drawings as the equivalent of, or a substitute for, project-specific design and assessment by an appropriately qualified professional.



STANDARD ARRANGEMENT OF 20mm
 WATER SERVICE AND RECYCLED WATER
 INSTALLATIONS

Standard
 Drawing
S2038

A	B	C		
---	---	---	--	--