



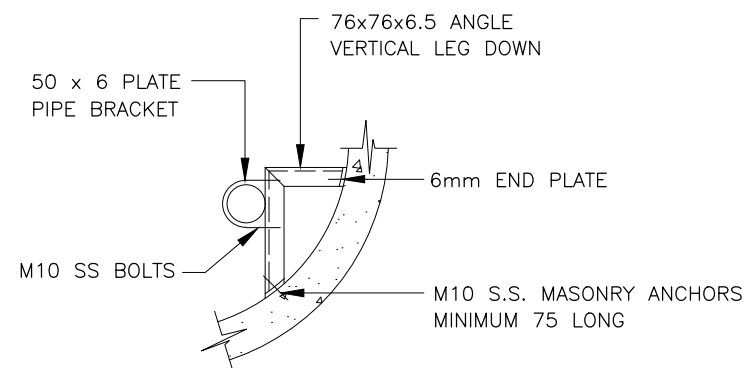


TYPE 1

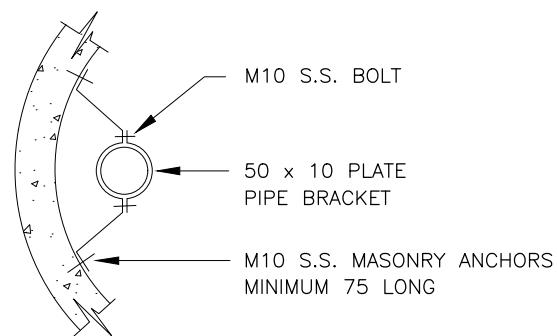

TYPE 2


PIPE SUPPORT BRACKET

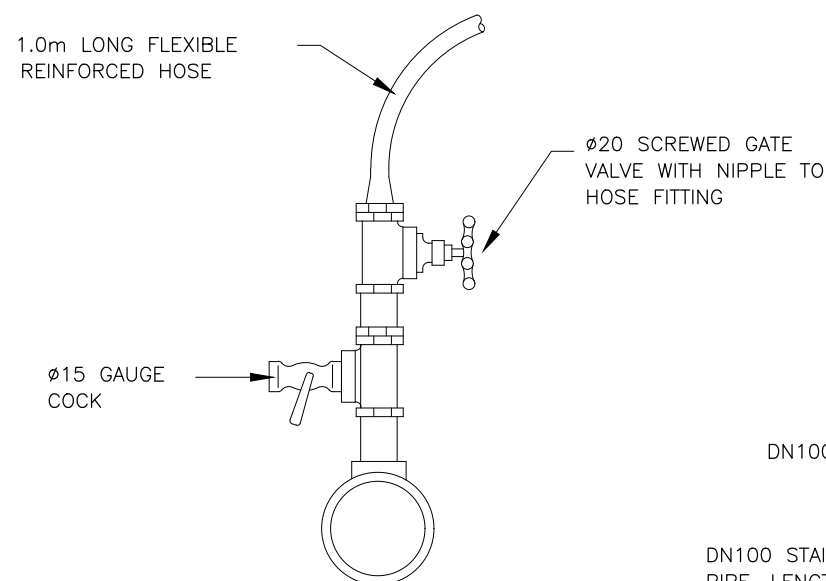


AIR RELEASE & GAUGE COCK

NOTES

1. ALL STEELWORK SHALL BE GRADE 316 STAINLESS STEEL.
2. PROJECT DRAWINGS SHALL FULLY DIMENSION FITTINGS.

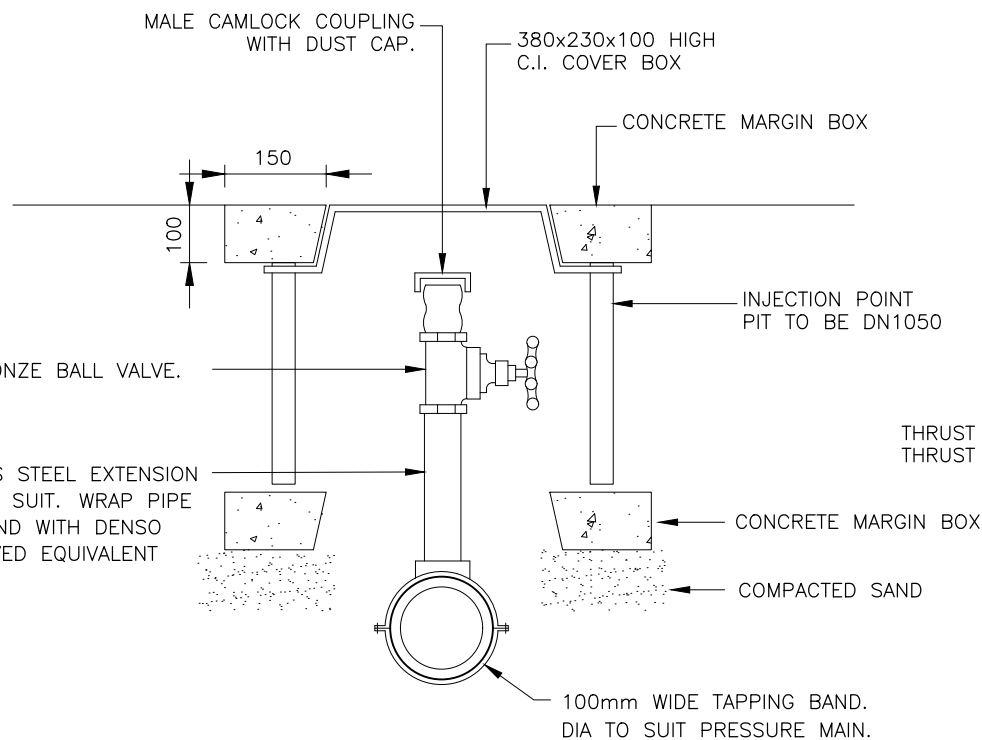


EMERGENCY PRESSURE MAIN CONNECTION DETAIL (IN-LINE CONFIGURATION)

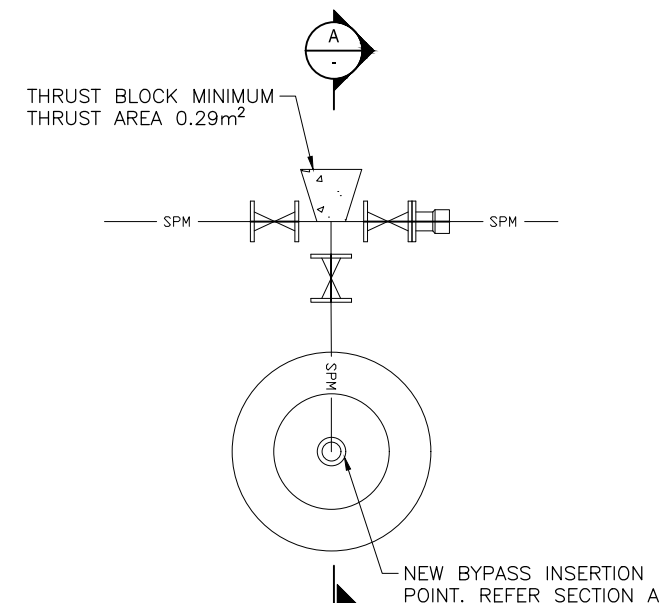

PLAN

BYPASS PRESSURE MAIN CONNECTION DETAIL (OFFSET CONFIGURATION)

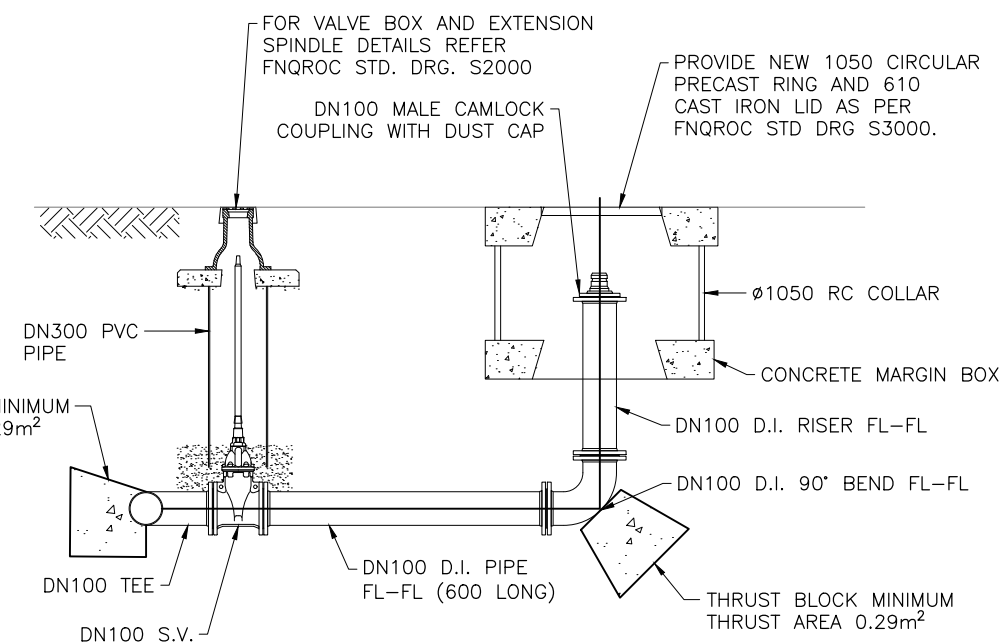

SECTION A - N.T.S

BYPASS PRESSURE MAIN CONNECTION DETAIL (OFFSET CONFIGURATION)

DISCLAIMER

The authors and sponsoring organisations shall have no liability or responsibility to the user or any other person or entity with respect to any liability, loss or damage caused or alleged to be caused, directly or indirectly, by the adoption and use of these Standard Drawings including, but not limited to, any interruption of service, loss of business or anticipatory profits, or consequential damages resulting from the use of these Standard Drawings. Persons must not rely on these Standard Drawings as the equivalent of, or a substitute for, project-specific design and assessment by an appropriately qualified professional.



SEWERAGE PUMP STATION DETAILS

Standard
Drawing
S3030

A	B	C		
---	---	---	--	--

REVISIONS	DATE
C BYPASS CONNECTION DETAIL ADDED	05/12/23
B CRC DRAWING ADOPTED	28/11/12
A ORIGINAL ISSUE	12/03/04